Material Test Report

Report Number: 9810-14
Issue Number: 1
Date Issued: 25/07/2026
Client: P F FORMATION
1774 WISEMANS FERRY ROAD, MAROOTA NSW 2756
Contact: 0418439923
Project Number: 9810
Project Name:
Project Location: 1 Patricia Fay Drive Maroota, NSW 2765
Work Request: 3364
Sample Number: S-3364A
Date Sampled: 30/06/2026
Dates Tested: 07/07/2026 - 08/07/2026
Sampling Method: Sampled by Client
The results apply to the sample as received
Preparation Method: In accordance with the test method
Site Selection: AS 1289.1.4.1
Sample Location: **Coarse Sand**

GEOTECH TESTING PTY LTD
ABN 71 076 676 321

Geotech Testing Pty Ltd
Penrith Laboratory
34 Borec Road Penrith NSW 2750
Phone: (02) 4722 2744
Email: matthew@geotech.com.au

NATA WORLD RECOGNISED ACCREDITATION

Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Mathew Morley
NSW Laboratory Operations Manager

Laboratory Number: 2734

Particle Size Distribution (AS1141.11.1)						
Sample Washing	Sample was Washed					
Sieve	Passed %	Passing Limits		Retained %	Retained Limits	
75 mm	**100**			0		
63 mm	**100**			0		
53 mm	**100**			0		
37.5 mm	**100**			0		
26.5 mm	**100**			0		
19 mm	**100**			0		
13.2 mm	**100**			0		
9.5 mm	**100**			0		
6.7 mm	**100**			0		
4.75 mm	**100**			0		
2.36 mm	**95**			5		
1.18 mm	**80**			15		
0.6 mm	**59**			22		
0.425 mm	**46**			12		
0.3 mm	**29**			17		
0.15 mm	**6**			24		
0.075 mm	**2**			4		

Clay and Fine Silt (AS 1141.33)		Min	Max
Volume of Clay and Silt (%)	4		

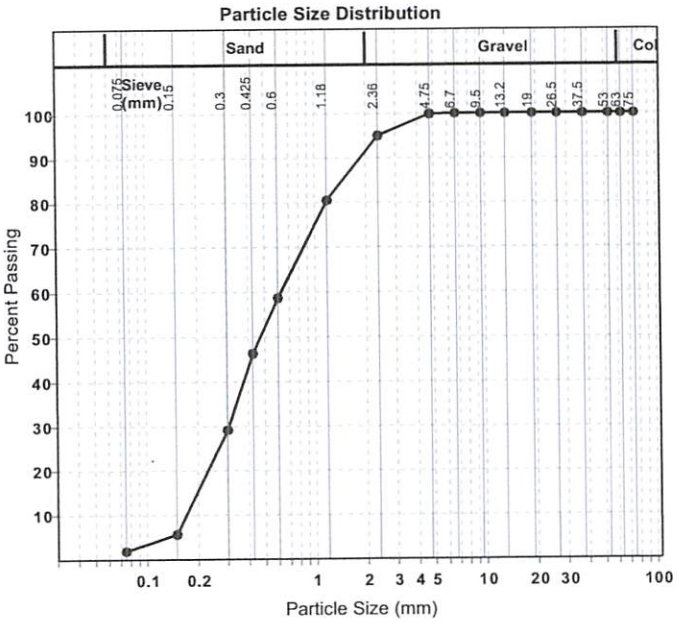

This document shall not be reproduced except in full without the approval of the laboratory.
Results relate only to the items tested/sampled.